ONICON SYSTEM-10 BTU METER WIRING DIAGRAM

FOR CONNECTION WITH ONICON F-4600 SERIES
INLINE ULTRASONIC FLOW METERS

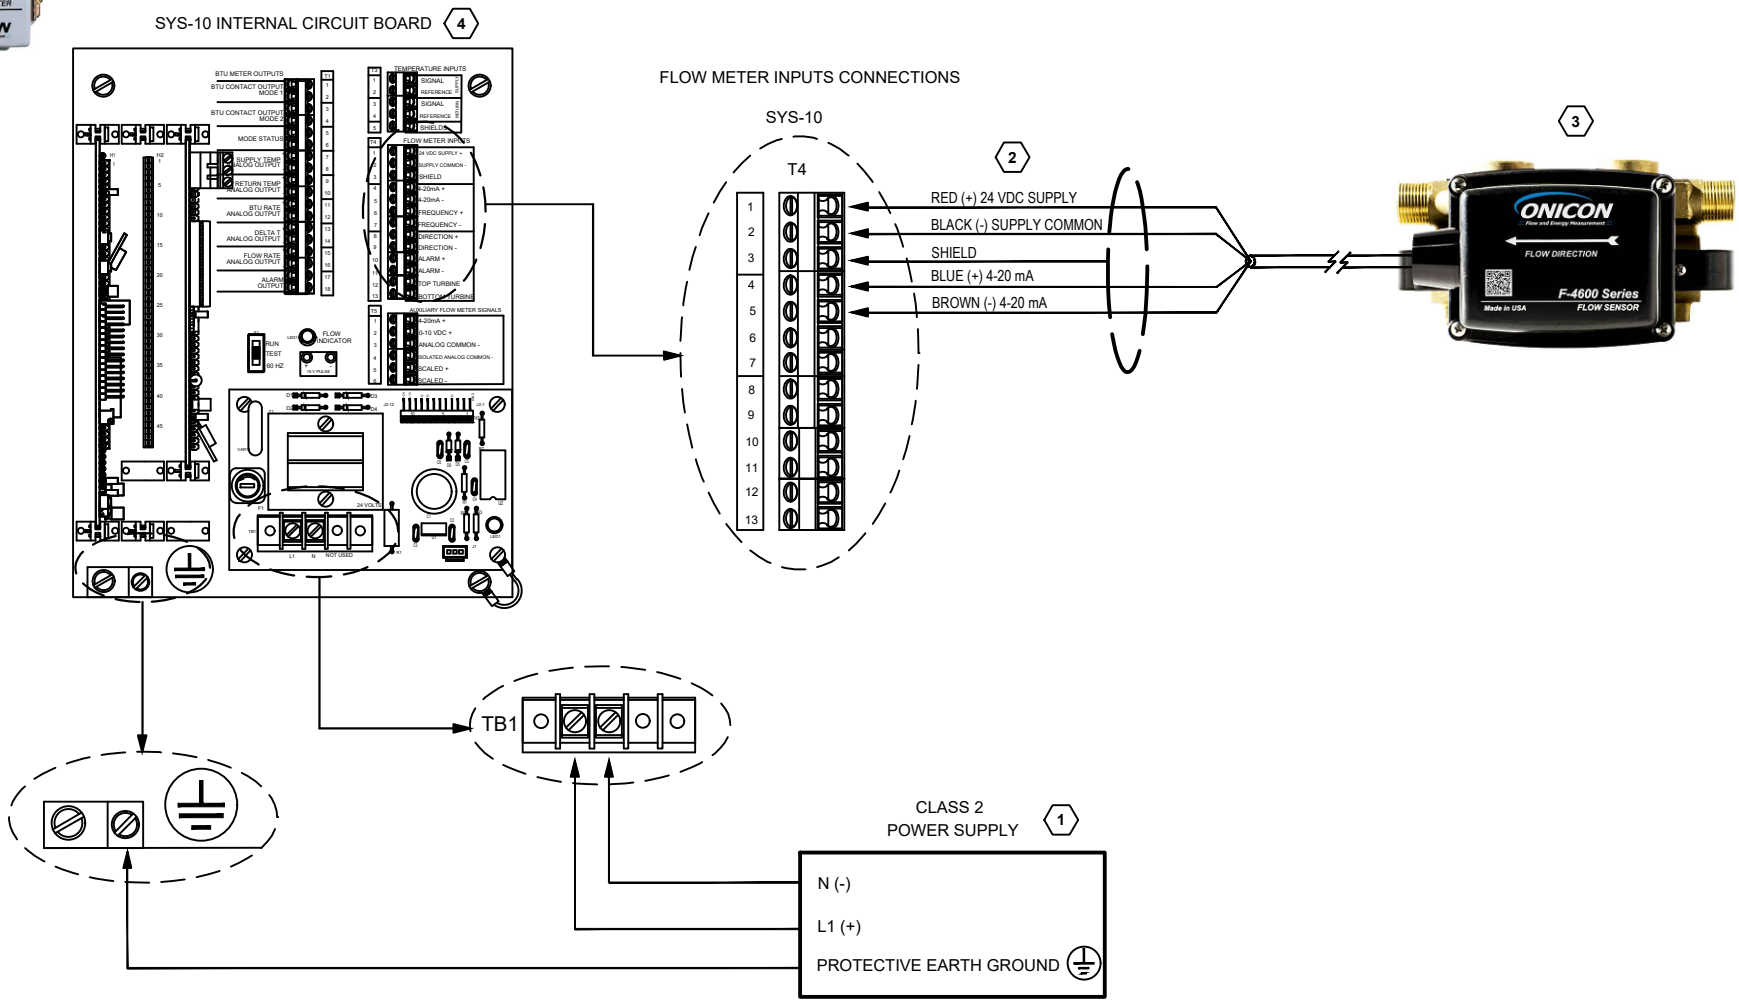

KEYED NOTES:

1. POWER SUPPLY (CLASS 2 POWER SUPPLY FOR 24 VAC) REQUIREMENT (INPUT VOLTAGE IS NOT FIELD SELECTABLE):
   - 24 VAC: 20-28 VAC, 50/60 Hz, 12 VA
   - 120 VAC: 108-132 VAC, 50/60 Hz, 15 VA
   - 240 VAC: 207-253 VAC, 50/60 Hz, 15 VA
2. FACTORY F-4600 WIRE COLORS ARE IDENTIFIED FROM THE FLOW METER. DO NOT REMOVE FACTORY CABLE.
3. REFER TO F-4600 SERIES IOM FOR ADDITIONAL WIRING INFORMATION.
4. REFER TO SYS-10 IOM FOR ADDITIONAL WIRING INFORMATION.

ONICON
Flow and Energy Measurement

Rev.A CAD-000365 DOC-0004010